


WELD 1/4" STEEL PLATE  
TO TOP OF CASING, FOR  
TEMPORARY CAP INSTALLED  
AFTER WELL ACCEPTANCE  
BY ENGINEER.

WELL HEADWORKS  
(SEE DWG. DD-902-06).

STEEL PIPE SUCTION CHAMBER

VARIES

24"

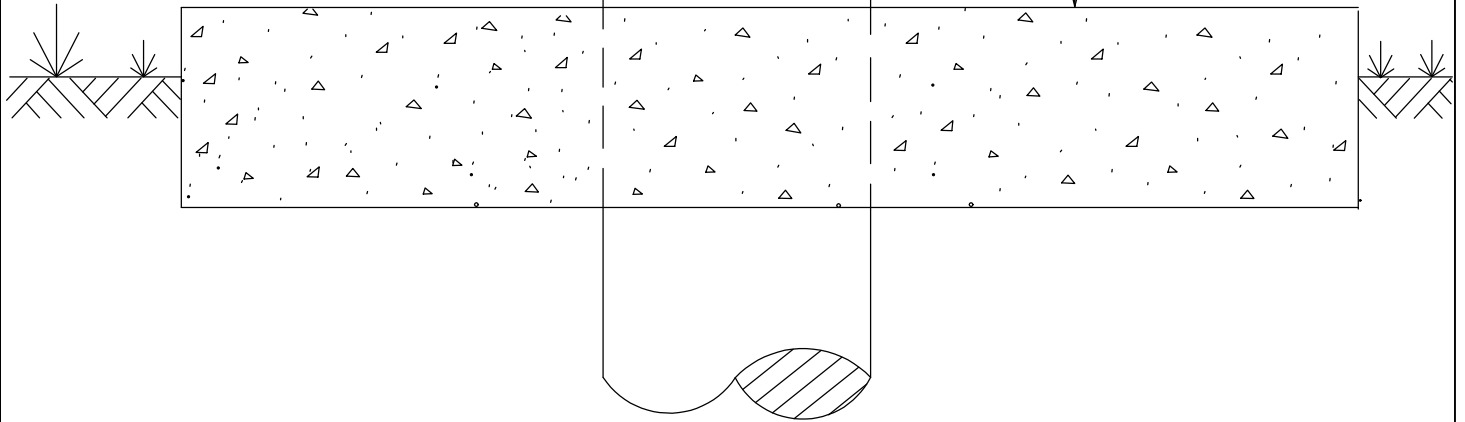

PROPERTY OF  
SAN ANTONIO WATER SYSTEM  
SAN ANTONIO, TEXAS

TEMPORARY CAP  
DETAIL

APPROVED

7-14-00

REVISED

DD-902-07

SHEET  
1 OF 1